



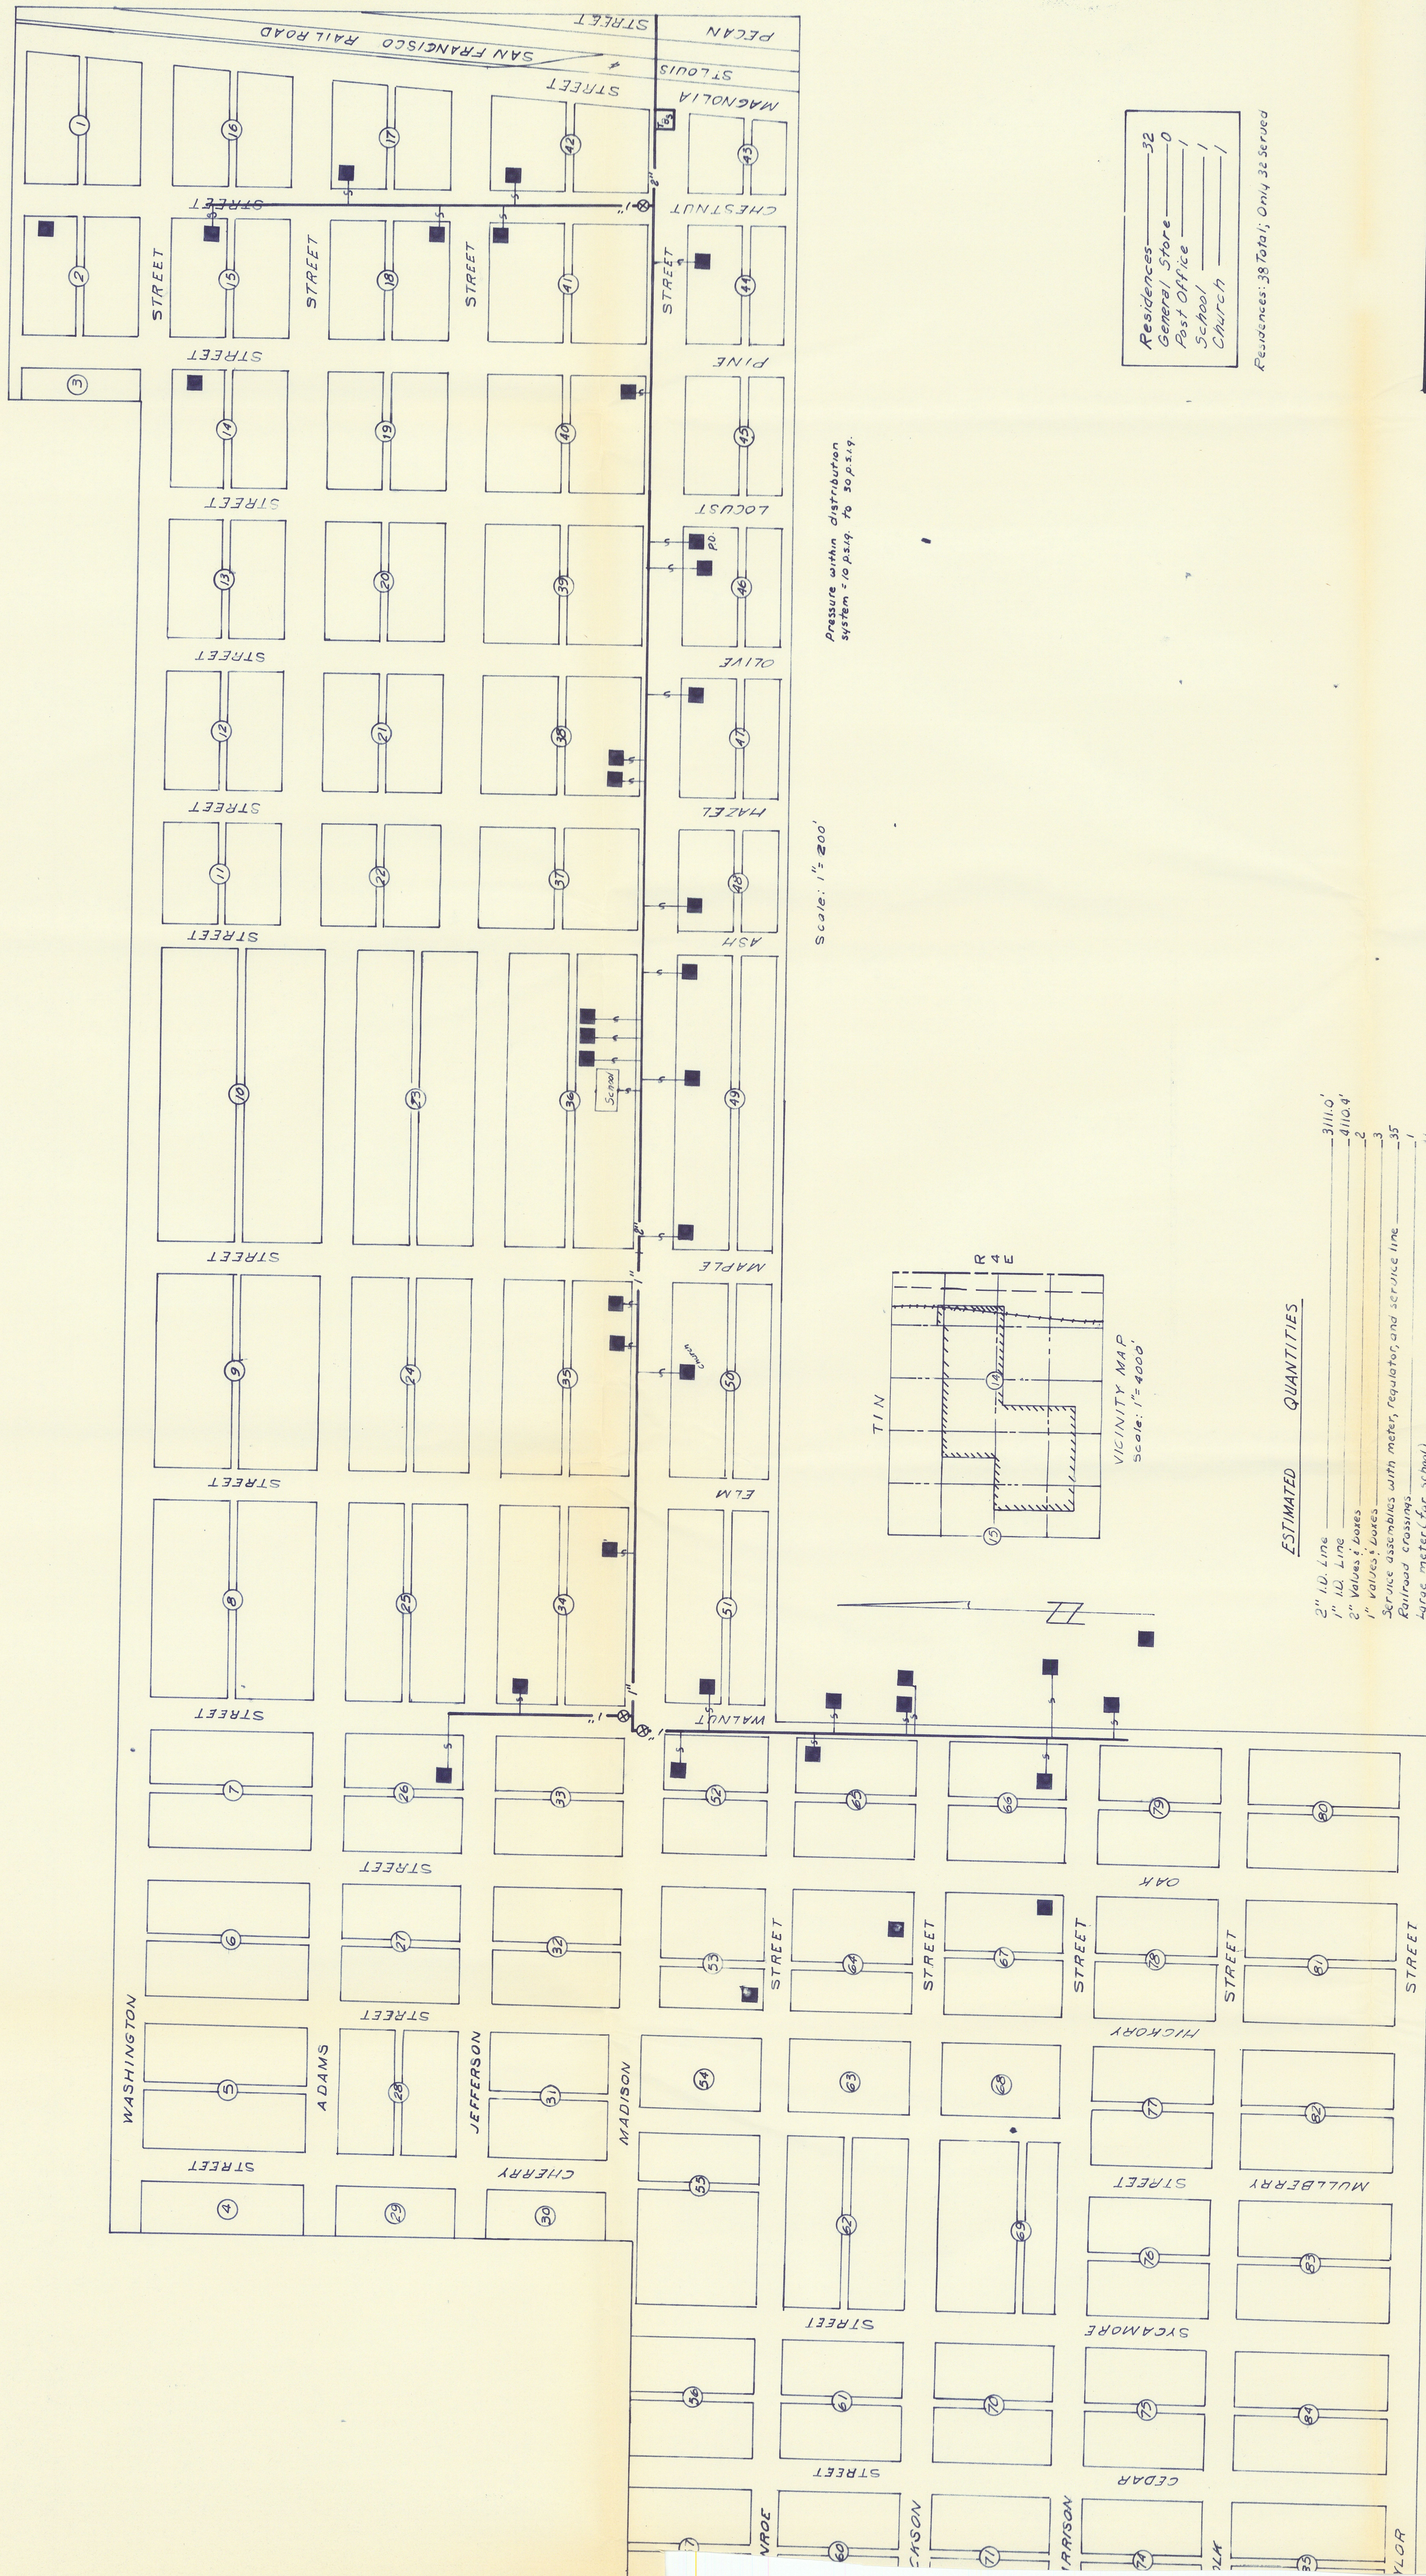

Pressure within distribution system 10 p.s.i.g. to 50 p.s.i.g.

Scale: 1" = 200'

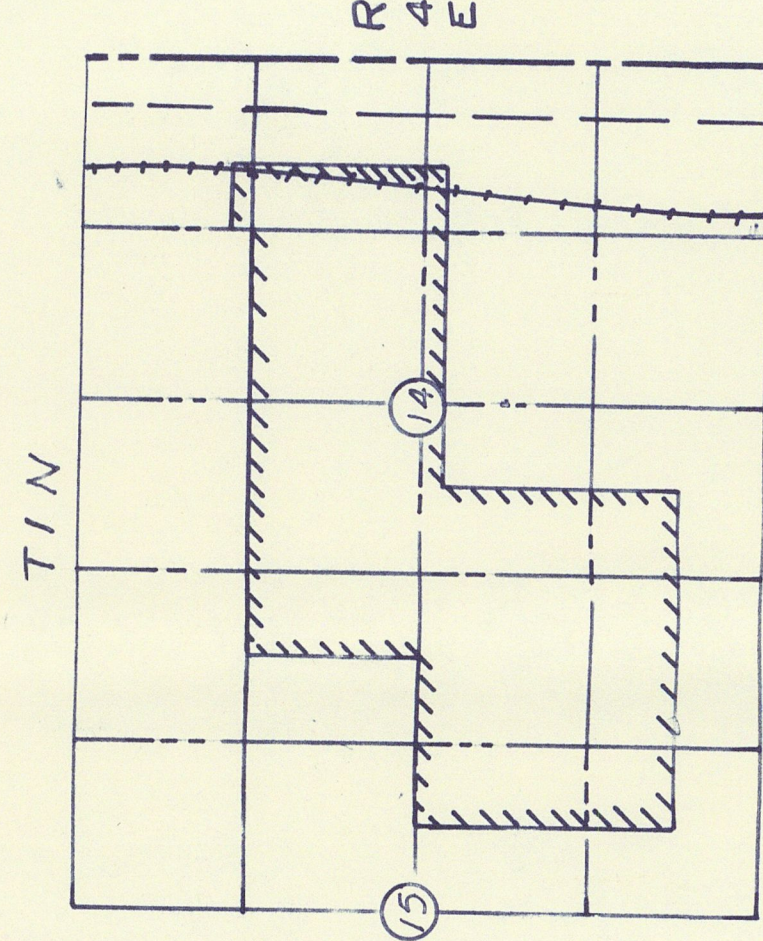

VICINITY MAP
Scale: 1" = 4000'

Residences	32
General Store	0
Post Office	1
School	1
Church	1

Residences: 32 Total; Only 32 Served

ESTIMATED QUANTITIES

2" I.D. Line	3111.0'
1" I.D. Line	4110.4'
2" Valves & Boxes	2
1" Valves & Boxes	3
Service assemblies with meter, regulator, and service line	35
Railroad crossings	1
Large meter (for school)	1
Town border station	1
Convert to natural gas burning equipment: School	1
Other	34

2" 2" Proposed Distribution Line
1" 1" Proposed Distribution Line
Valves
Town Border Station
Highway
Railroad
Service Line

LEGEND

PRELIMINARY PLANS FOR PROPOSED GAS SYSTEMS FOR GLASS SAND PLANTS IN PONTOTOC AND JOHNSTON COUNTIES, AND TOWNS IN THE AREA INCLUDING MURRAY COUNTY

HICKORY DISTRIBUTION SYSTEM
RALPH W. DELANEY
CONSULTING ENGINEER
ADA, OKLAHOMA
SCALE: AS NOTED