


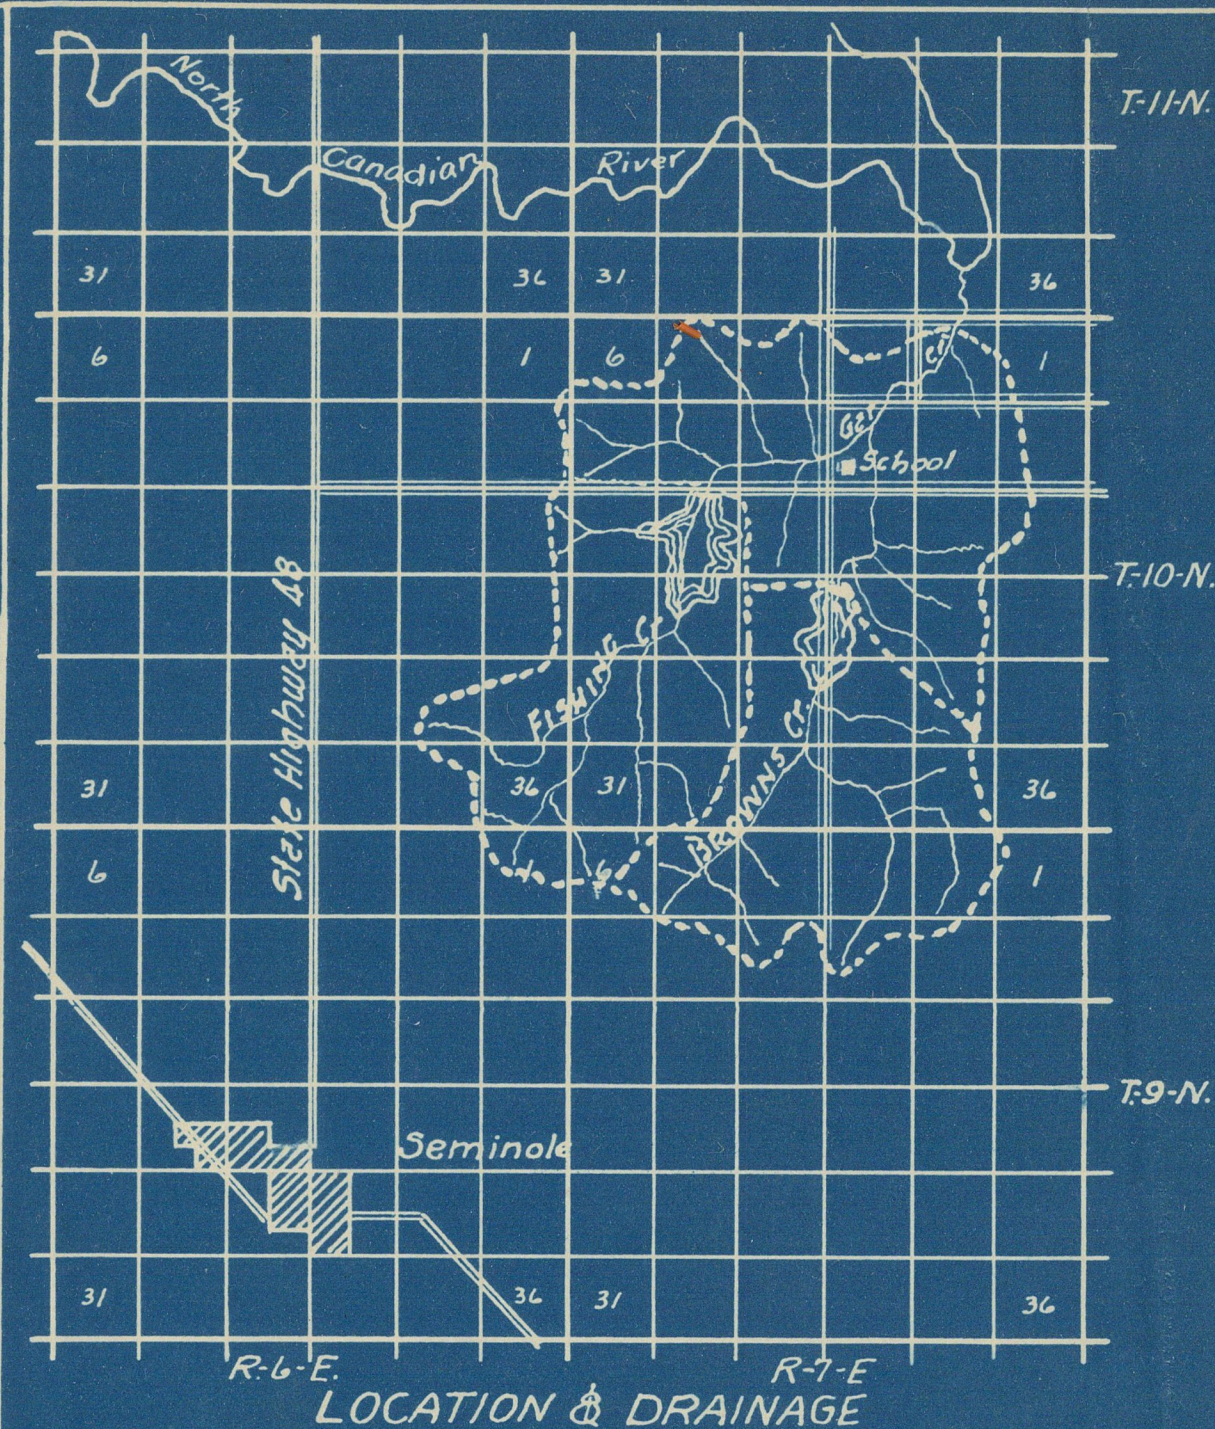
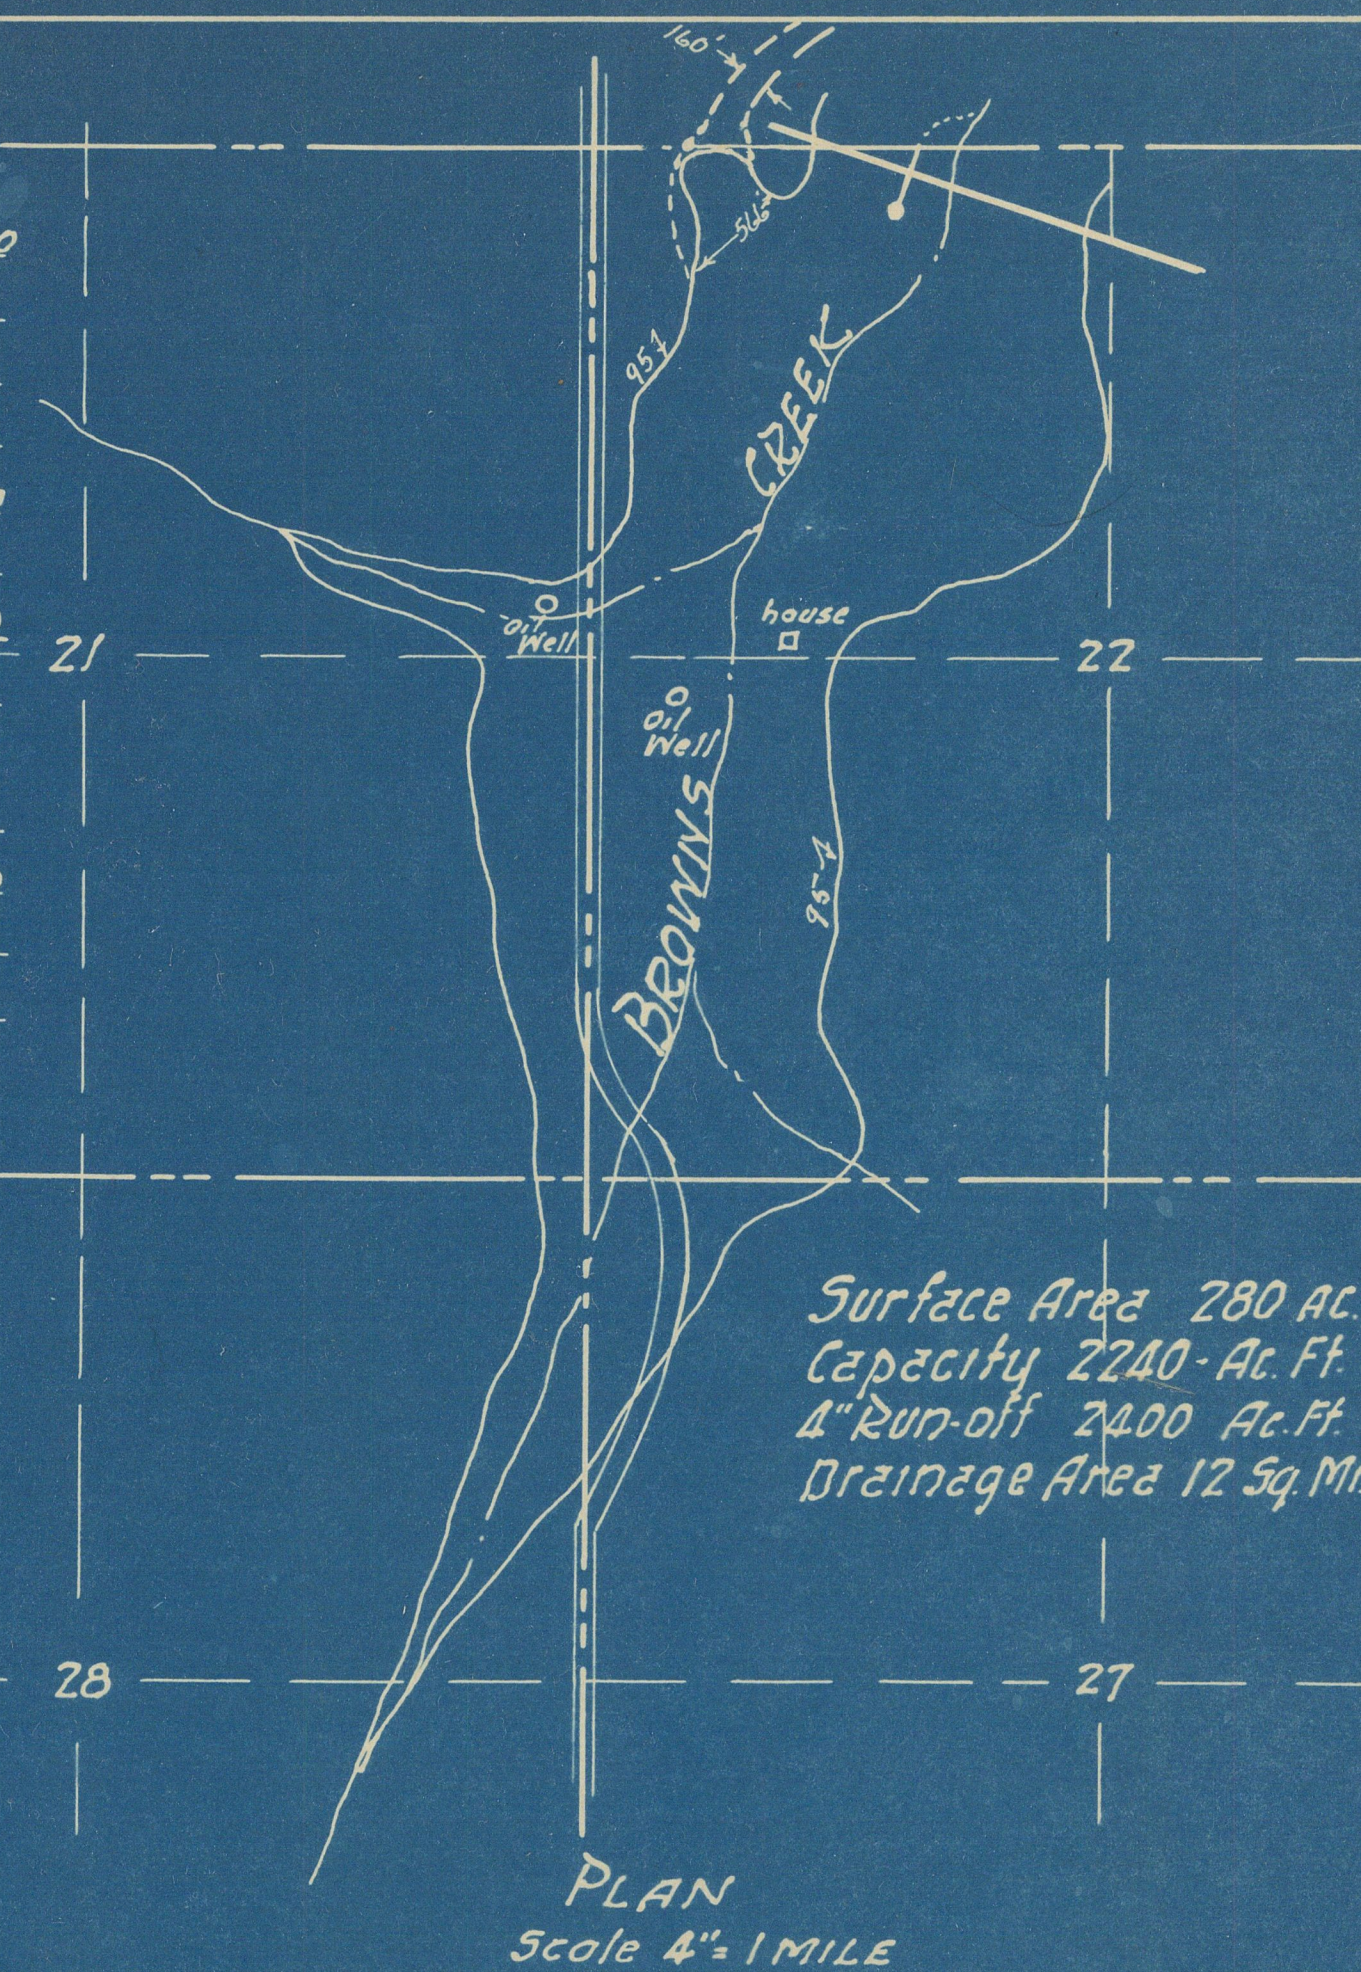
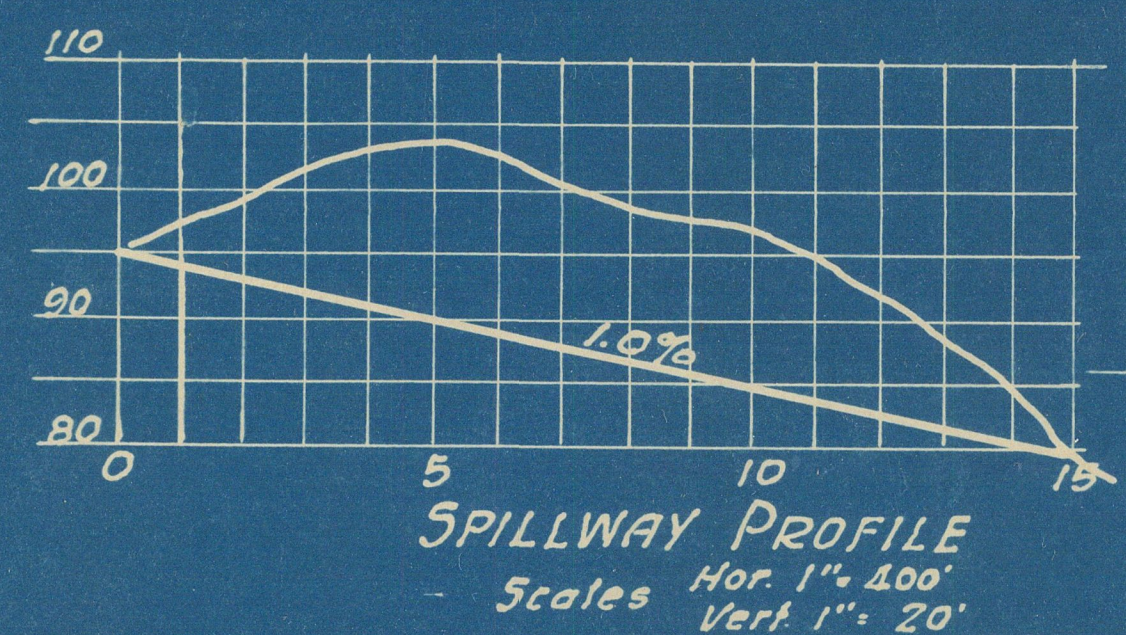
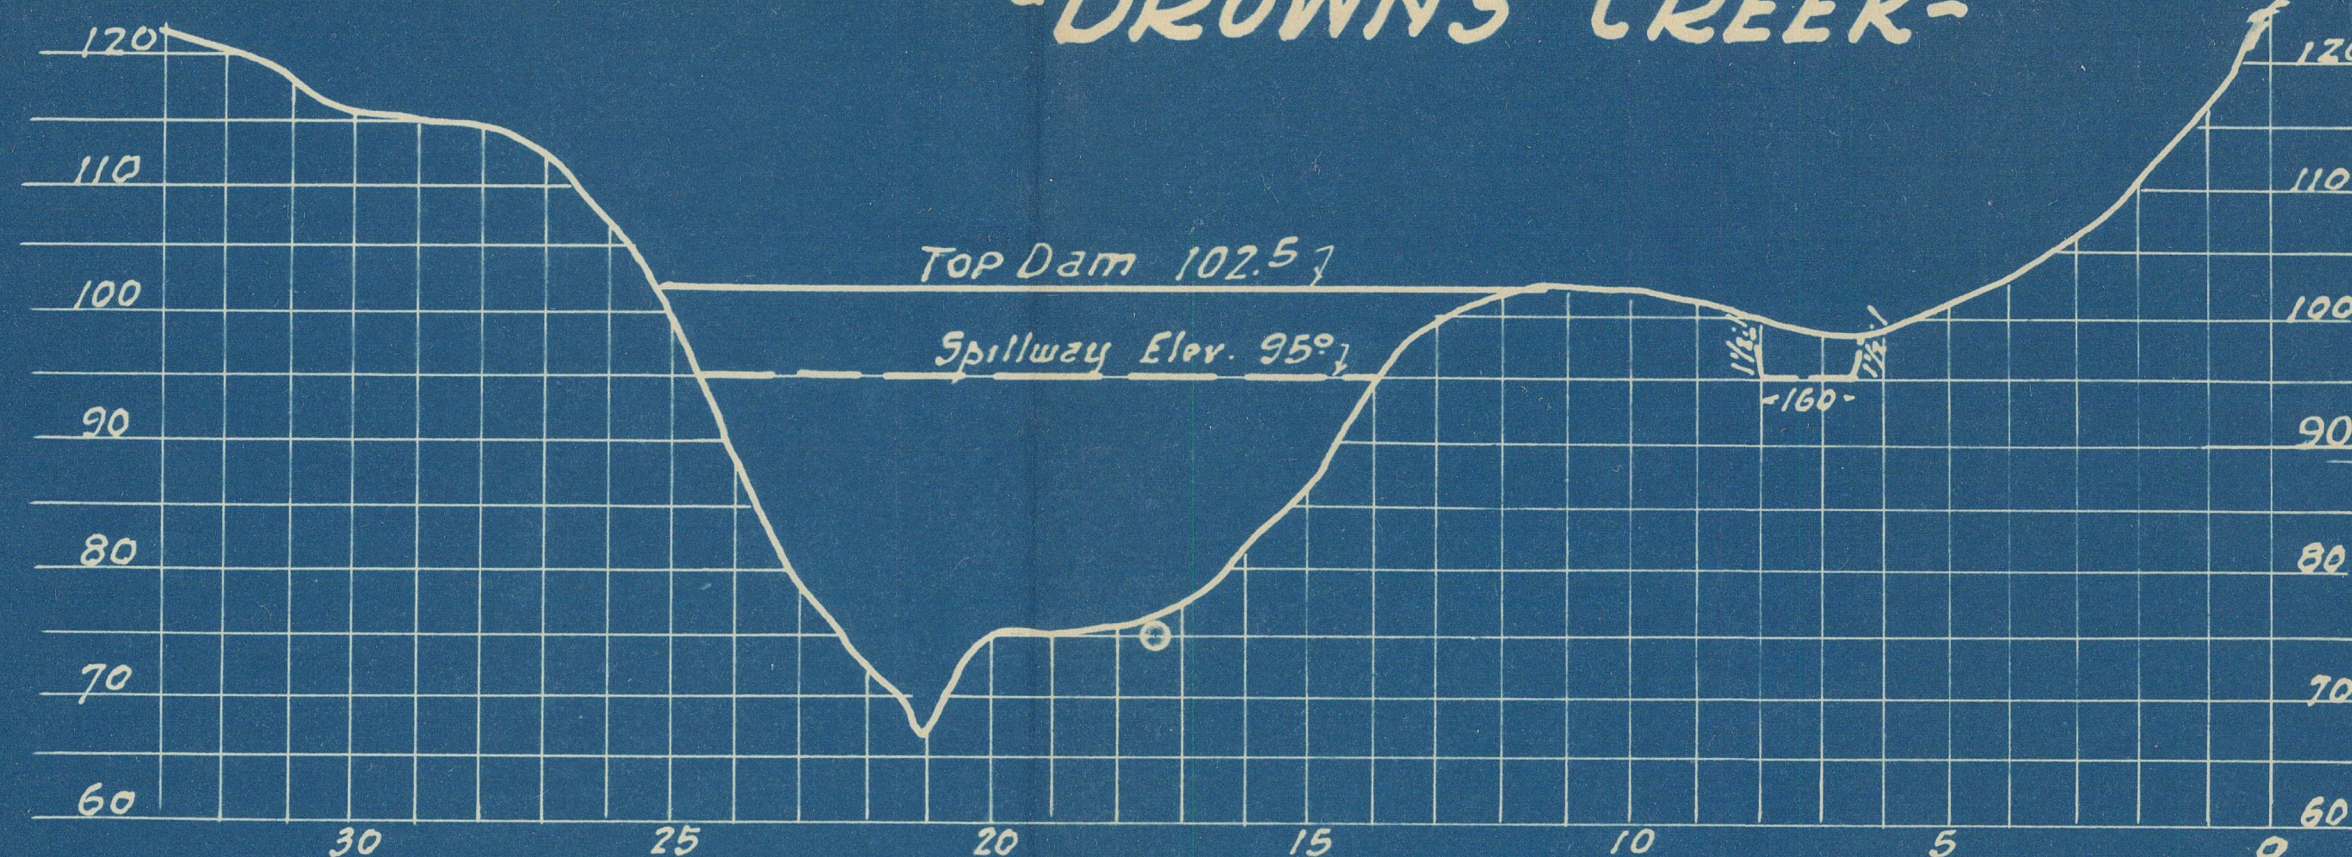


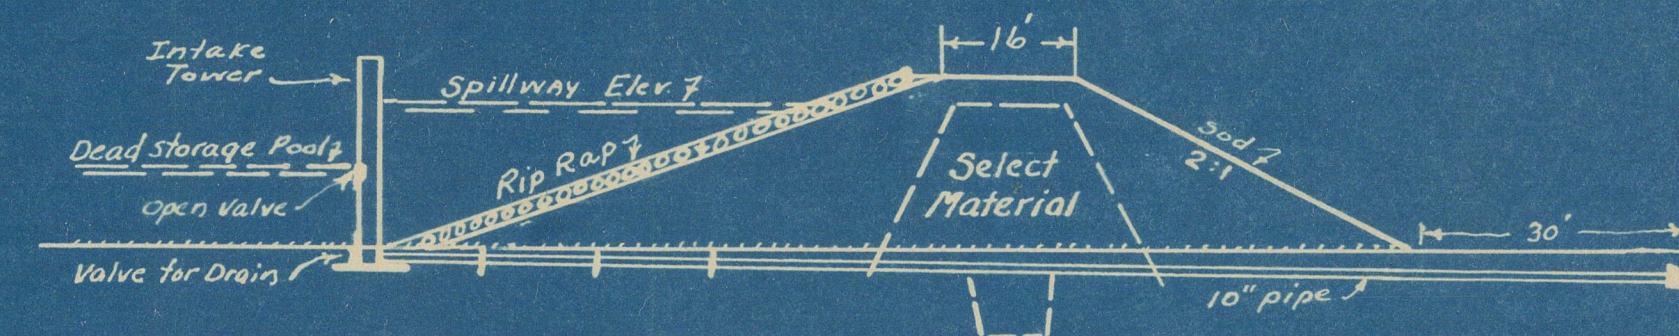

-BROWN'S CREEK-

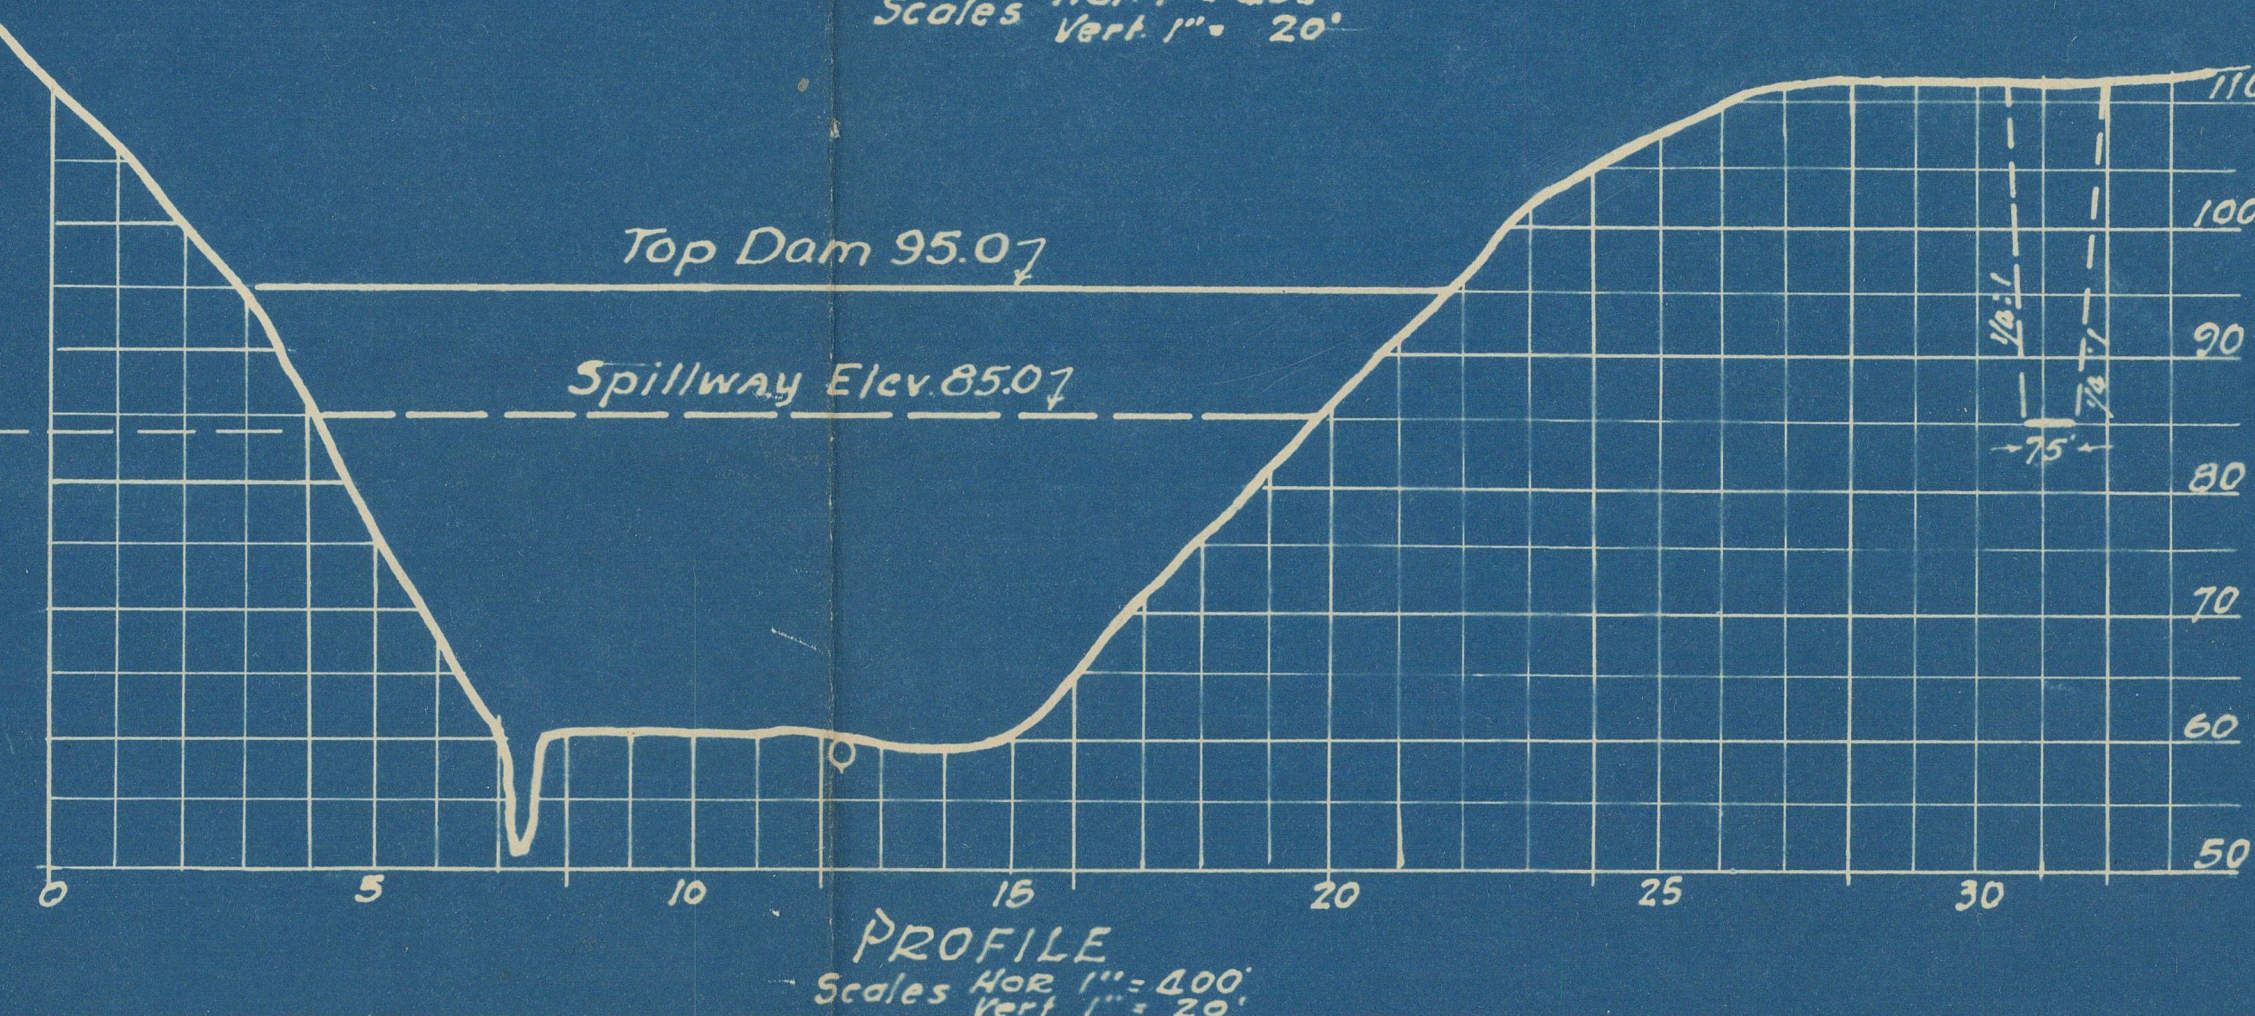

-FISHING CREEK-

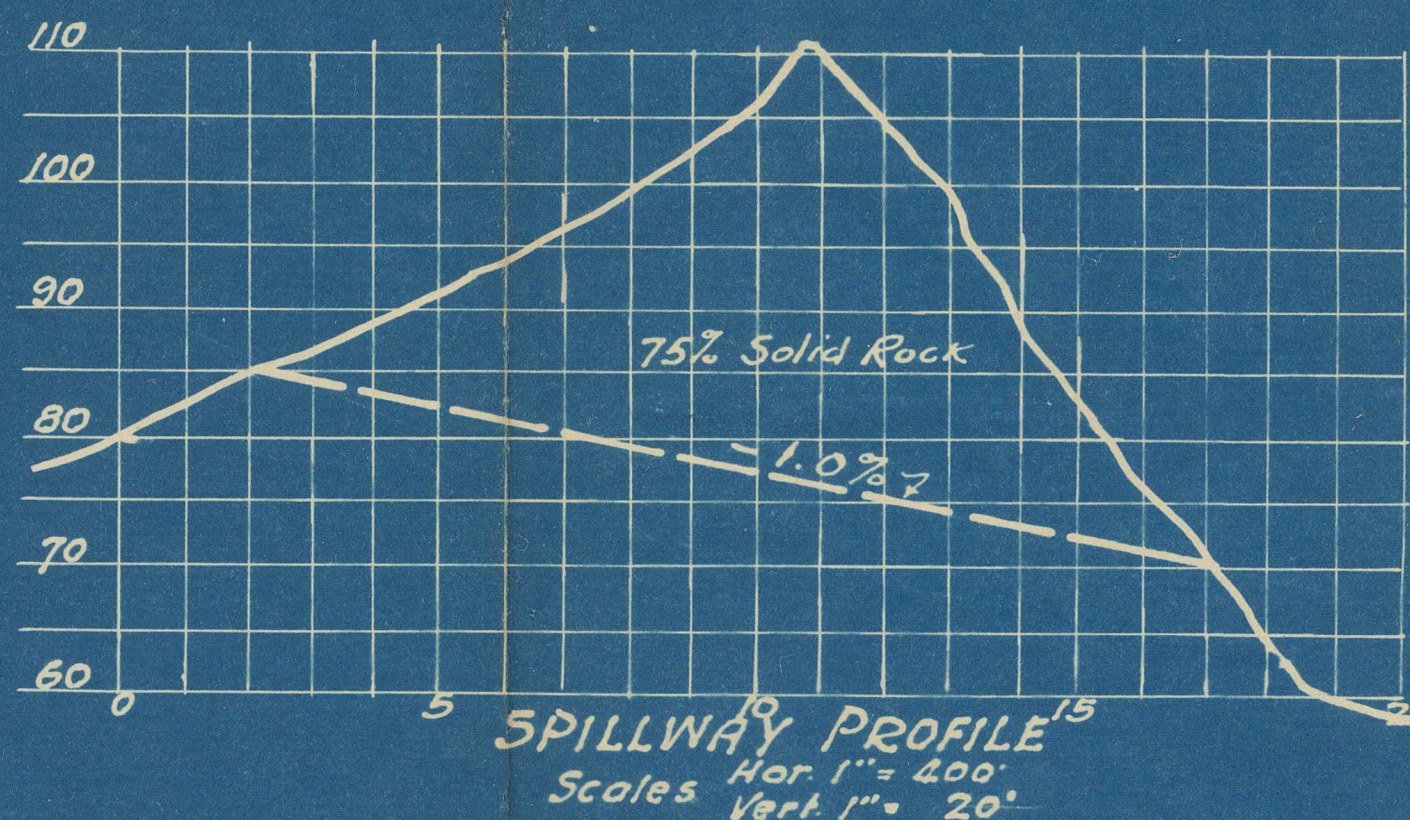

Note: Open valve to be placed in intake tower on both pools, also Outlet Valve to drain entire pool, as listed:
Brown's Creek - Open Valve, elev. 85.0, Outlet - elev. 75.0
Fishing Creek - Open Valve, elev. 70.0, Outlet - elev. 59.0

Rip Rap

Rip Rap to be 36" random dump.

OKLAHOMA PLANNING & RESOURCES BOARD
DIVISION OF WATER RESOURCES
GARR CREEK FLOOD PROTECTION
T-10-N — R-7-E
SEMINOLE COUNTY

F. L. VAUGHAN - DIRECTOR W. C. BURNHAM - ENGINEER
DATE 12-22-37 DRAWING NO. 244